


Certificate of Analysis

Bacteriostatic Water 10 mL

Compound: Bacteriostatic Water
Amount: 10 mL
Laboratory ID: V251008-22 009
Lot Number: BW001
Date Reported: 10/21/2025

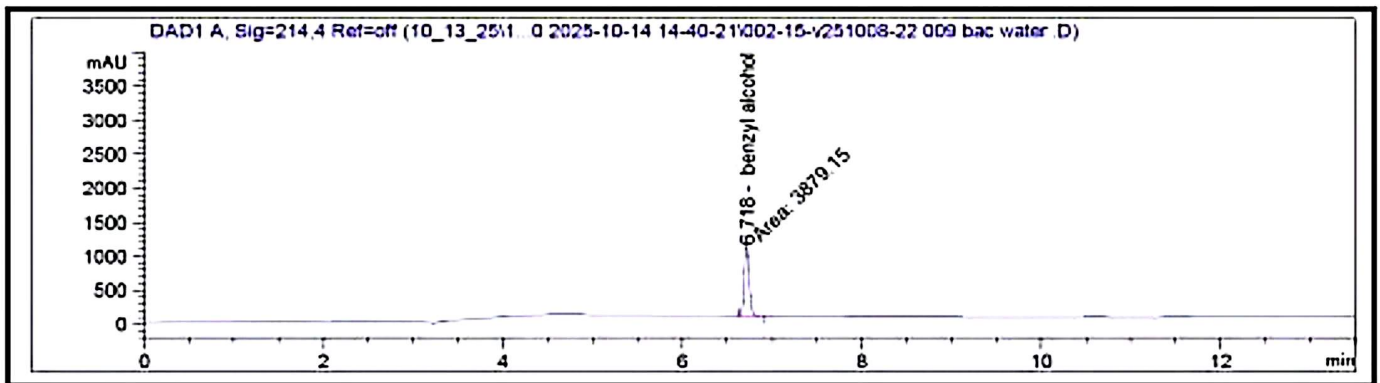

Analysis	Method	Result	Acceptable Range	Pass/ Fail
Benzyl Alcohol Content	HPLC-UV/VIS	1.08%	0.72%-1.08%	Pass*
pH	AOAC 981.12	5.88	4.0-7.0	Pass*

* Pass/Fail according to US Pharmacopoeia <1231> limits.




Report By: Dustin Newman, Laboratory Director on 10/21/2025



Approved By: Tori Johnson, Operations Manager on 10/21/2025



Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch.

